


TEL. 01422 885087 FAX 01422 883721 24HOUR 07740 322 454 Email [des@genelab.plus.com](mailto:des@genelab.plus.com)


### Hot Water Test - 15 minutes

The graph below shows data obtained during a 16-minute test on water which contained C. diff spores and was at a temperature of 75 degrees centigrade. 'Log' represents the number of spores. Even at 80 degrees over 15 minutes, the reduction of spores was insignificant.

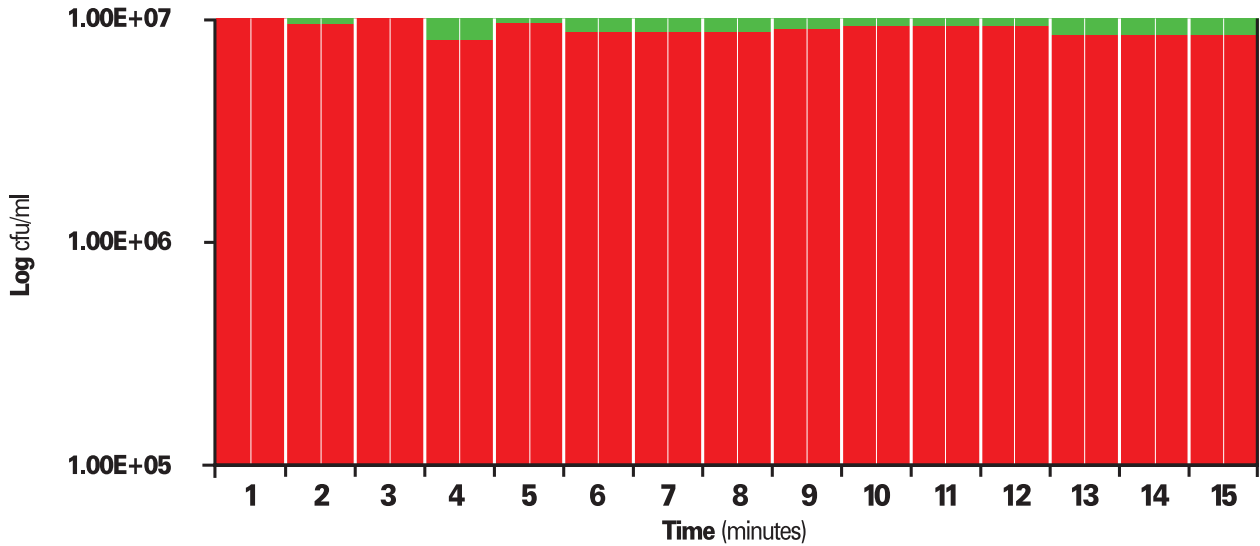

### OTEX Test - 2.5 minutes

This graph shows data obtained during a test known as an EU Suspension Test on OTEXed water with C. diff. You will see that even after only two-and-a-half minutes, there was no viable trace of spores.

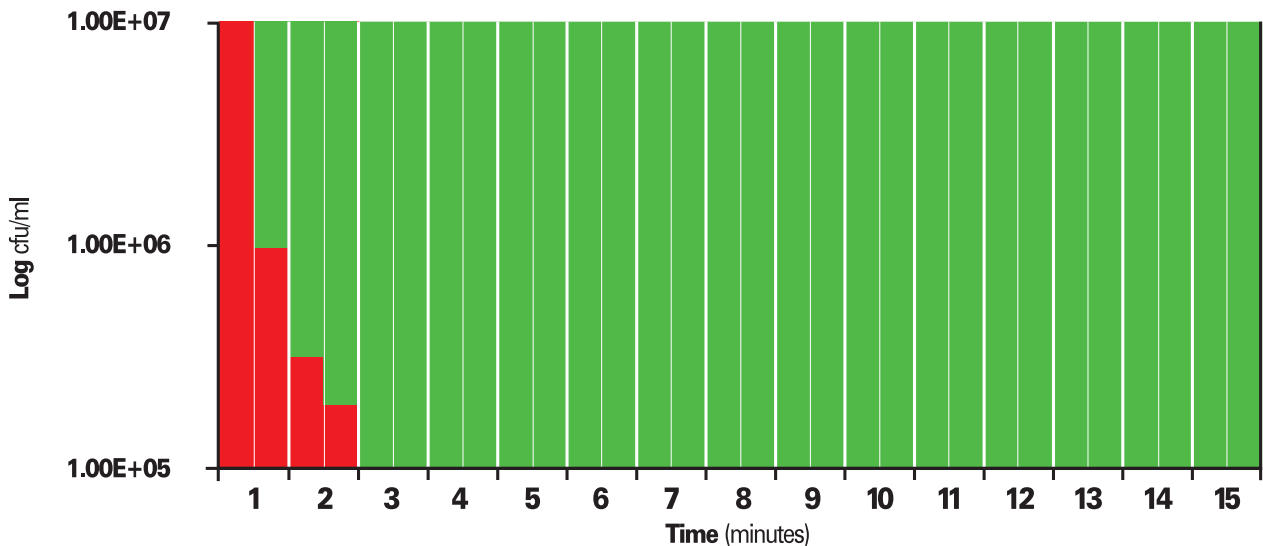


D O'Connor B.Sc.Ci.BioL M.I.F.S.T.